REV.	ZONE	ECN NO.	DATE	BY	CKR	APP.

Controls, C-AD 9/4/2003 2:37 PM d36-e1126_4.dwg

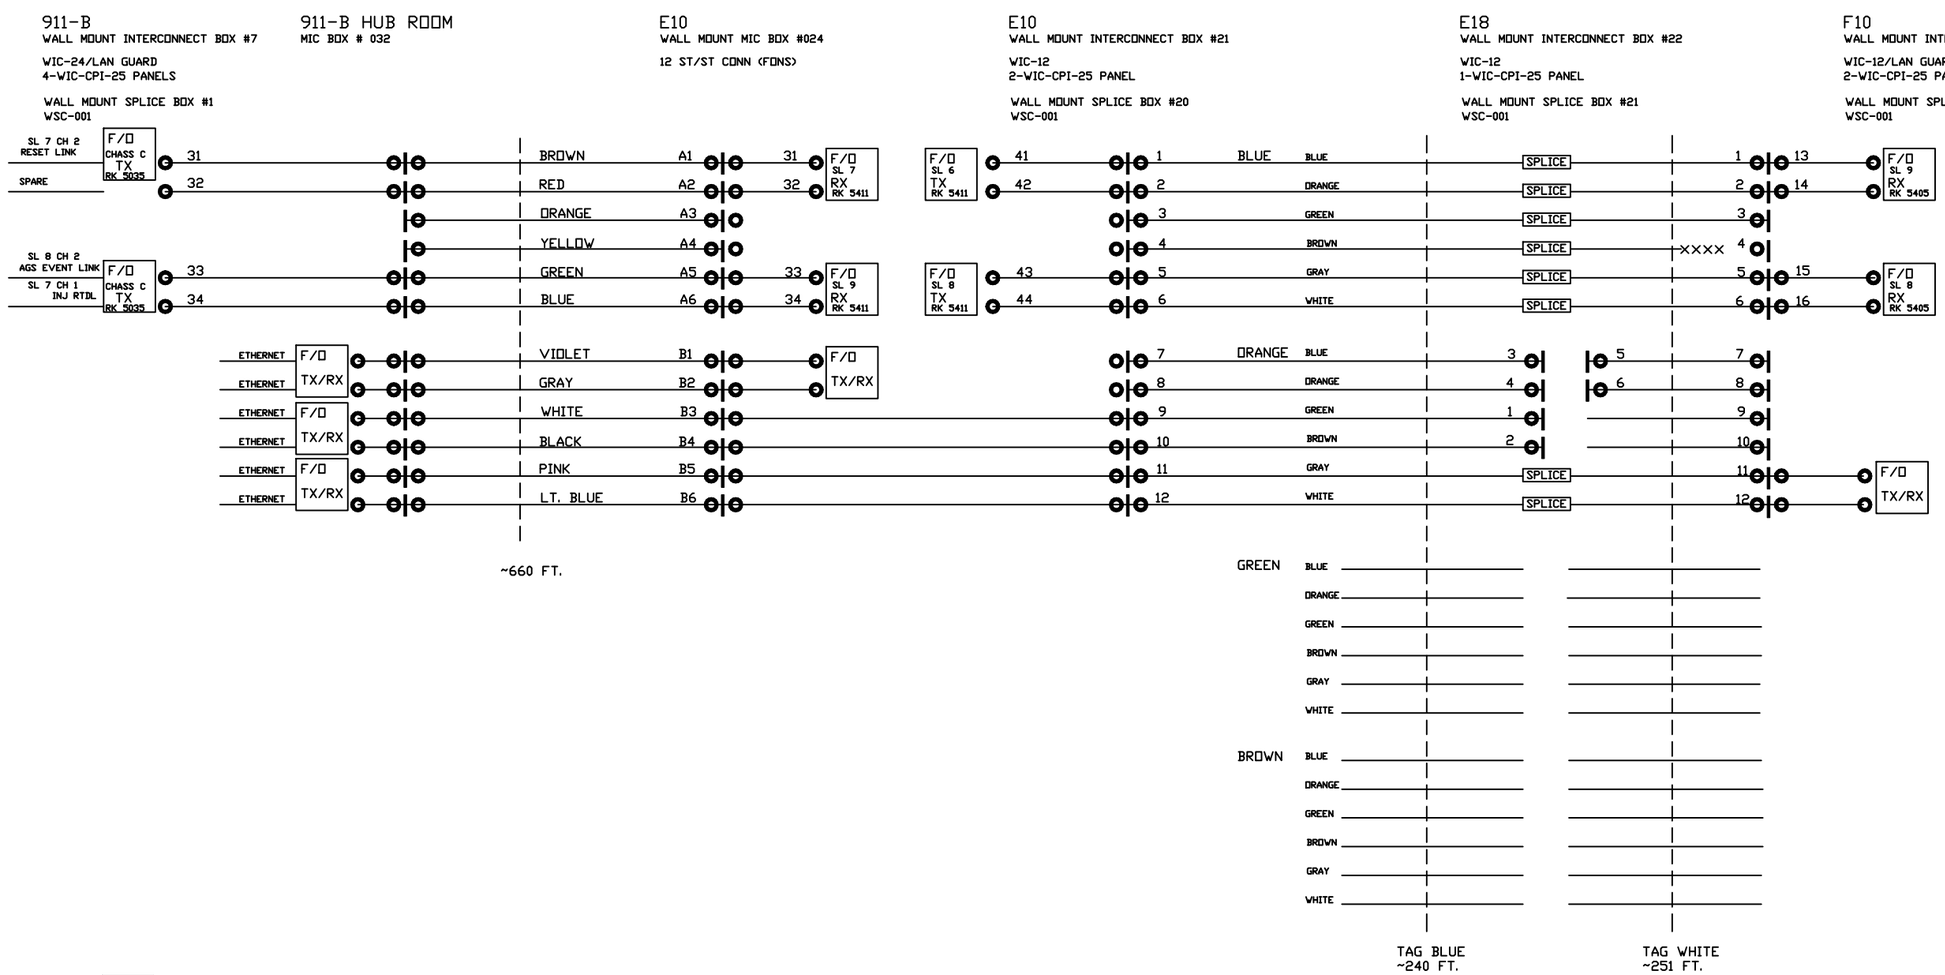

F/O TX
F/O RX
F/O TX OR RX CARD
94028164 (TX)
94028097 (RX)

CONNECTOR

F/O TX/RX
ETHERNET TRANSCEIVER

SPLICE
FUSION SPLICE

F/O TX
F/O RX
MATH ASSOC.
TX OR RX

NOTE: F/O TX FOR TIMING LINKS ARE LOCATED IN 911-B MEZZANINE. F/O JUMPER TO HUB ROOM IS REQUIRED.

INTERBUILDING CABLE IS A 24 FIBER LOOSE TUBE ARMORED CABLE, EXCEPT 911-B TO E-10 WHICH IS A 12 FIBER CABLE.

ALL CABLES ARE 62.5/125 FIBER.

NOTE: BLUE BUFFER, BROWN FIBER IS NO GOOD, BROKEN IN F-10.

-3	-2	-1	REF DESIGNATOR	ITEM NO.	DESCRIPTION	MAT'L DWG NO./BNL NO.
QTY REQD						

INTERPRET IN GENERAL ACCORDANCE WITH ASME Y14.24M-1989
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES
DECIMAL TOLERANCES .X ±.030 .XX ±.015 .XXX ±.005
ANGULAR TOLERANCE ± .5°
NA FINISH
BREAK SHARP EDGES MAX. XX MIN. XX
OUTSTANDING ECN

Q.A. CATEGORY A-3

		DATE
DRAWN BY	Ed Koropsak	9/4/03
CHECKED BY	NOBODY	
DESIGN APPROVAL		
ENGINEER APPROVAL	NONE	
SUPVR. APPROVAL		

NEXT ASSEMBLY

BROOKHAVEN NATIONAL LABORATORY
UPTON, N.Y. 11973
AGS CONTROLS
FIBER OPTIC PATHS
E10 LINE

SIZE D | DRAWING NUMBER D36-E1126 | REV. A

MATERIAL: — | SCALE: FULL | WEIGHT: – | SHEET 4 OF 8

*AUTOCAD